

ORDINANCE 1288 -A

AN ORDINANCE OF THE CITY OF PAYETTE, IDAHO, AMENDING SECTION 13.04.020 OF THE PAYETTE MUNICIPAL CODE TO ALLOW WATER MAINS IN THE CITY OF PAYETTE TO BE CONSTRUCTED OF PRESSURE CLASS 350 DUCTILE IRON PIPE AND TO ALLOW THREE-QUARTER INCH TYPE K COPPER SERVICE LINES; SETTING AN EFFECTIVE DATE; ESTABLISHING SEVERABILITY; ESTABLISHING A REPEALER.

WHEREAS, the Payette City staff have considered the purpose and impact of constructing water infrastructure in the City and have recommended certain changes in order to better accomplish the purpose of the ordinance;

WHEREAS, the City Council believes certain amendments to the City's water infrastructure construction regulations are necessary.

NOW, THEREFORE, BE IT ORDAINED BY THE MAYOR AND CITY COUNCIL OF PAYETTE, IDAHO;

Section 1. Section 13.04.020 of the Payette Municipal Code, is hereby amended to read as follows:

13.04.020 Private Construction--Permit Required--Application Information--Construction Materials Required: Any person desiring to construct waterworks on or below any street or alley, or desiring to construct any extension of the water-works, in the City, shall first obtain from the City Clerk a permit for such construction upon application being filed with the City Clerk. The application shall state the name of the person applying, the approximate location of the waterworks, the legal description of the land or lots to be serviced by the waterworks, and the owners of the said lots so served, together with the proposed size and type of pipe to be laid and the approximate cost. ~~The water main shall be a minimum of Class 51 ductile iron pipe at eight inches (8") in diameter.~~ Water mains shall be a minimum of eight inches (8") in diameter, and be constructed of Pressure Class 350 ductile iron (minimum). The pipe shall be manufactured in accordance with ANSI/AWWA Standard 151/A21.51 and shall be lined with Portland cement mortar meeting or exceeding ANSI/AWWA Standard C104/A21.4. Pipe joints shall be the push on type with rubber gaskets. Mechanical joints with or flanges shall be used where necessary. Metallic wedges shall be installed in each joint to assure electrical conductance for pipe thawing procedures. Connections to the main line shall be with saddles and corporation stops of either Ford or Mueller manufacture. Service lines shall be a minimum of ~~one inch (1")~~ three-quarter inch (3/4") diameter class type K copper.

Section 2. This Ordinance may be published in summary form allowed by Idaho Code.

Section 3. This Ordinance shall be in full force and effect immediately upon passage and publication as required by the laws of the State of Idaho.

Section 4. Any ordinances or resolutions which are in conflict with this Ordinance are hereby repealed, but only insofar as the conflict exists.

Section 5. If any portion of this Ordinance should be found to be unconstitutional or unenforceable for any reason, the remainder of the Ordinance shall be applied to effectuate the purposes of this Ordinance.

PASSED and APPROVED by the Mayor and City Council of the City of Payette, Idaho this 7th day of January, 2008.

CITY OF PAYETTE, IDAHO

by *Douglas E. Henderson*
DOUGLAS E. HENDERSON, Mayor


ATTEST:

Mary Cordova
Mary Cordova, City Clerk

State of Idaho)
) ss.
County of Payette)

On this 7th day of January, in the year of 2008, before me Jennifer A. Kelley, a notary public, personally appeared MARY CORDOVA and DOUGLAS E. HENDERSON, personally known to me to be the persons whose name is subscribed to the within instrument, and acknowledged to me that they executed the same on behalf of the City of Payette in their official capacities as Mayor and City Clerk.

Jennifer A. Kelley
Notary Public for Idaho
Residing at: *Payette Id*
Commission expires: *12-11-2008*

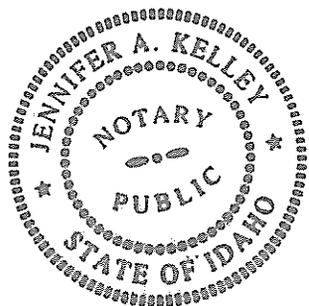

SUMMARY OF ORDINANCE 1288-A

Ordinance 1288 is an ordinance of the City Of Payette, Idaho, adopted January 7, 2008. The ordinance may be descriptively known as the Payette ordinance changing required construction materials for water infrastructure. Ordinance 1288 amends section 13.04.020 of the Payette Municipal Code to set a minimum standard for water mains of 8" in diameter and constructed of Pressure Class 350 ductile iron, and to allow for a minimum service line of 3/4" diameter type K copper. The Ordinance provides a severability clause, provides for publication by summary, sets an effective date, and establishes a repealer.

I, Bert L. Osborn, City Attorney for the City of Payette Idaho, certify that I am familiar with Ordinance 1288 of the City of Payette, Idaho and with the foregoing summary. The summary is true and complete and provides adequate notice to the public. The full text is on file with the Payette City Clerk and shall promptly be made available to any citizen upon request.

Dated this 8th day of January, 2008.



Bert L. Osborn

*Published
1-16-08*